



BNL-104588-2014-TECH

AGS/AD/Tech Note No. 160;BNL-104588-2014-IR

HEBT STEERING (HEBST)

E. Gill

January 1980

Collider Accelerator Department
Brookhaven National Laboratory

U.S. Department of Energy

USDOE Office of Science (SC)

Notice: This technical note has been authored by employees of Brookhaven Science Associates, LLC under Contract No.DE-AC02-76CH00016 with the U.S. Department of Energy. The publisher by accepting the technical note for publication acknowledges that the United States Government retains a non-exclusive, paid-up, irrevocable, world-wide license to publish or reproduce the published form of this technical note, or allow others to do so, for United States Government purposes.

DISCLAIMER

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, nor any of their contractors, subcontractors, or their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or any third party's use or the results of such use of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof or its contractors or subcontractors. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

Accelerator Department
BROOKHAVEN NATIONAL LABORATORY
Associated Universities, Inc.
Upton, New York 11973

AGS DIVISION TECHNICAL NOTE

NO. 160

HEBT STEERING (HEBST)

E. Gill, S. Naase, F. Martin and J. Dabrowski

January 14, 1980


PURPOSE: To read position monitors and control four dipoles in HEBT line refer to HEBT drawing.

LOCATIONS: Two horizontal dipoles ND 321 and ND 348, two vertical dipoles NP 319 and NP 343. Position monitors are located at BPM8 (NX355) and BPM9 (NX390), also read tank 9 current and BPM7.

METHOD: Using a high speed digitizer and multiplex switch to read position monitors. Block diagram #1.

OPERATION: Program name HEBST located in R R (25,13) - This program allows the user to read or correct the steering at BPM8 and BPM9 it also reads tank 9 current and BPM7. The device used to read is a 1024 bit digitizer which start reading data by DIGTG (Digitizer Trigger). It is also necessary to read multiplex DIMXA to switch position monitor signals.

If you go into feedback loop it will read data and correct automatically till tolerance is reached. If you just want to plot data it will switch through position monitors and store data and let you display in many forms. See examples of different plots. It will take about one minute to iterate all four dipoles to a tolerance of ± 6 counts. The calibration is 20 counts per mm.

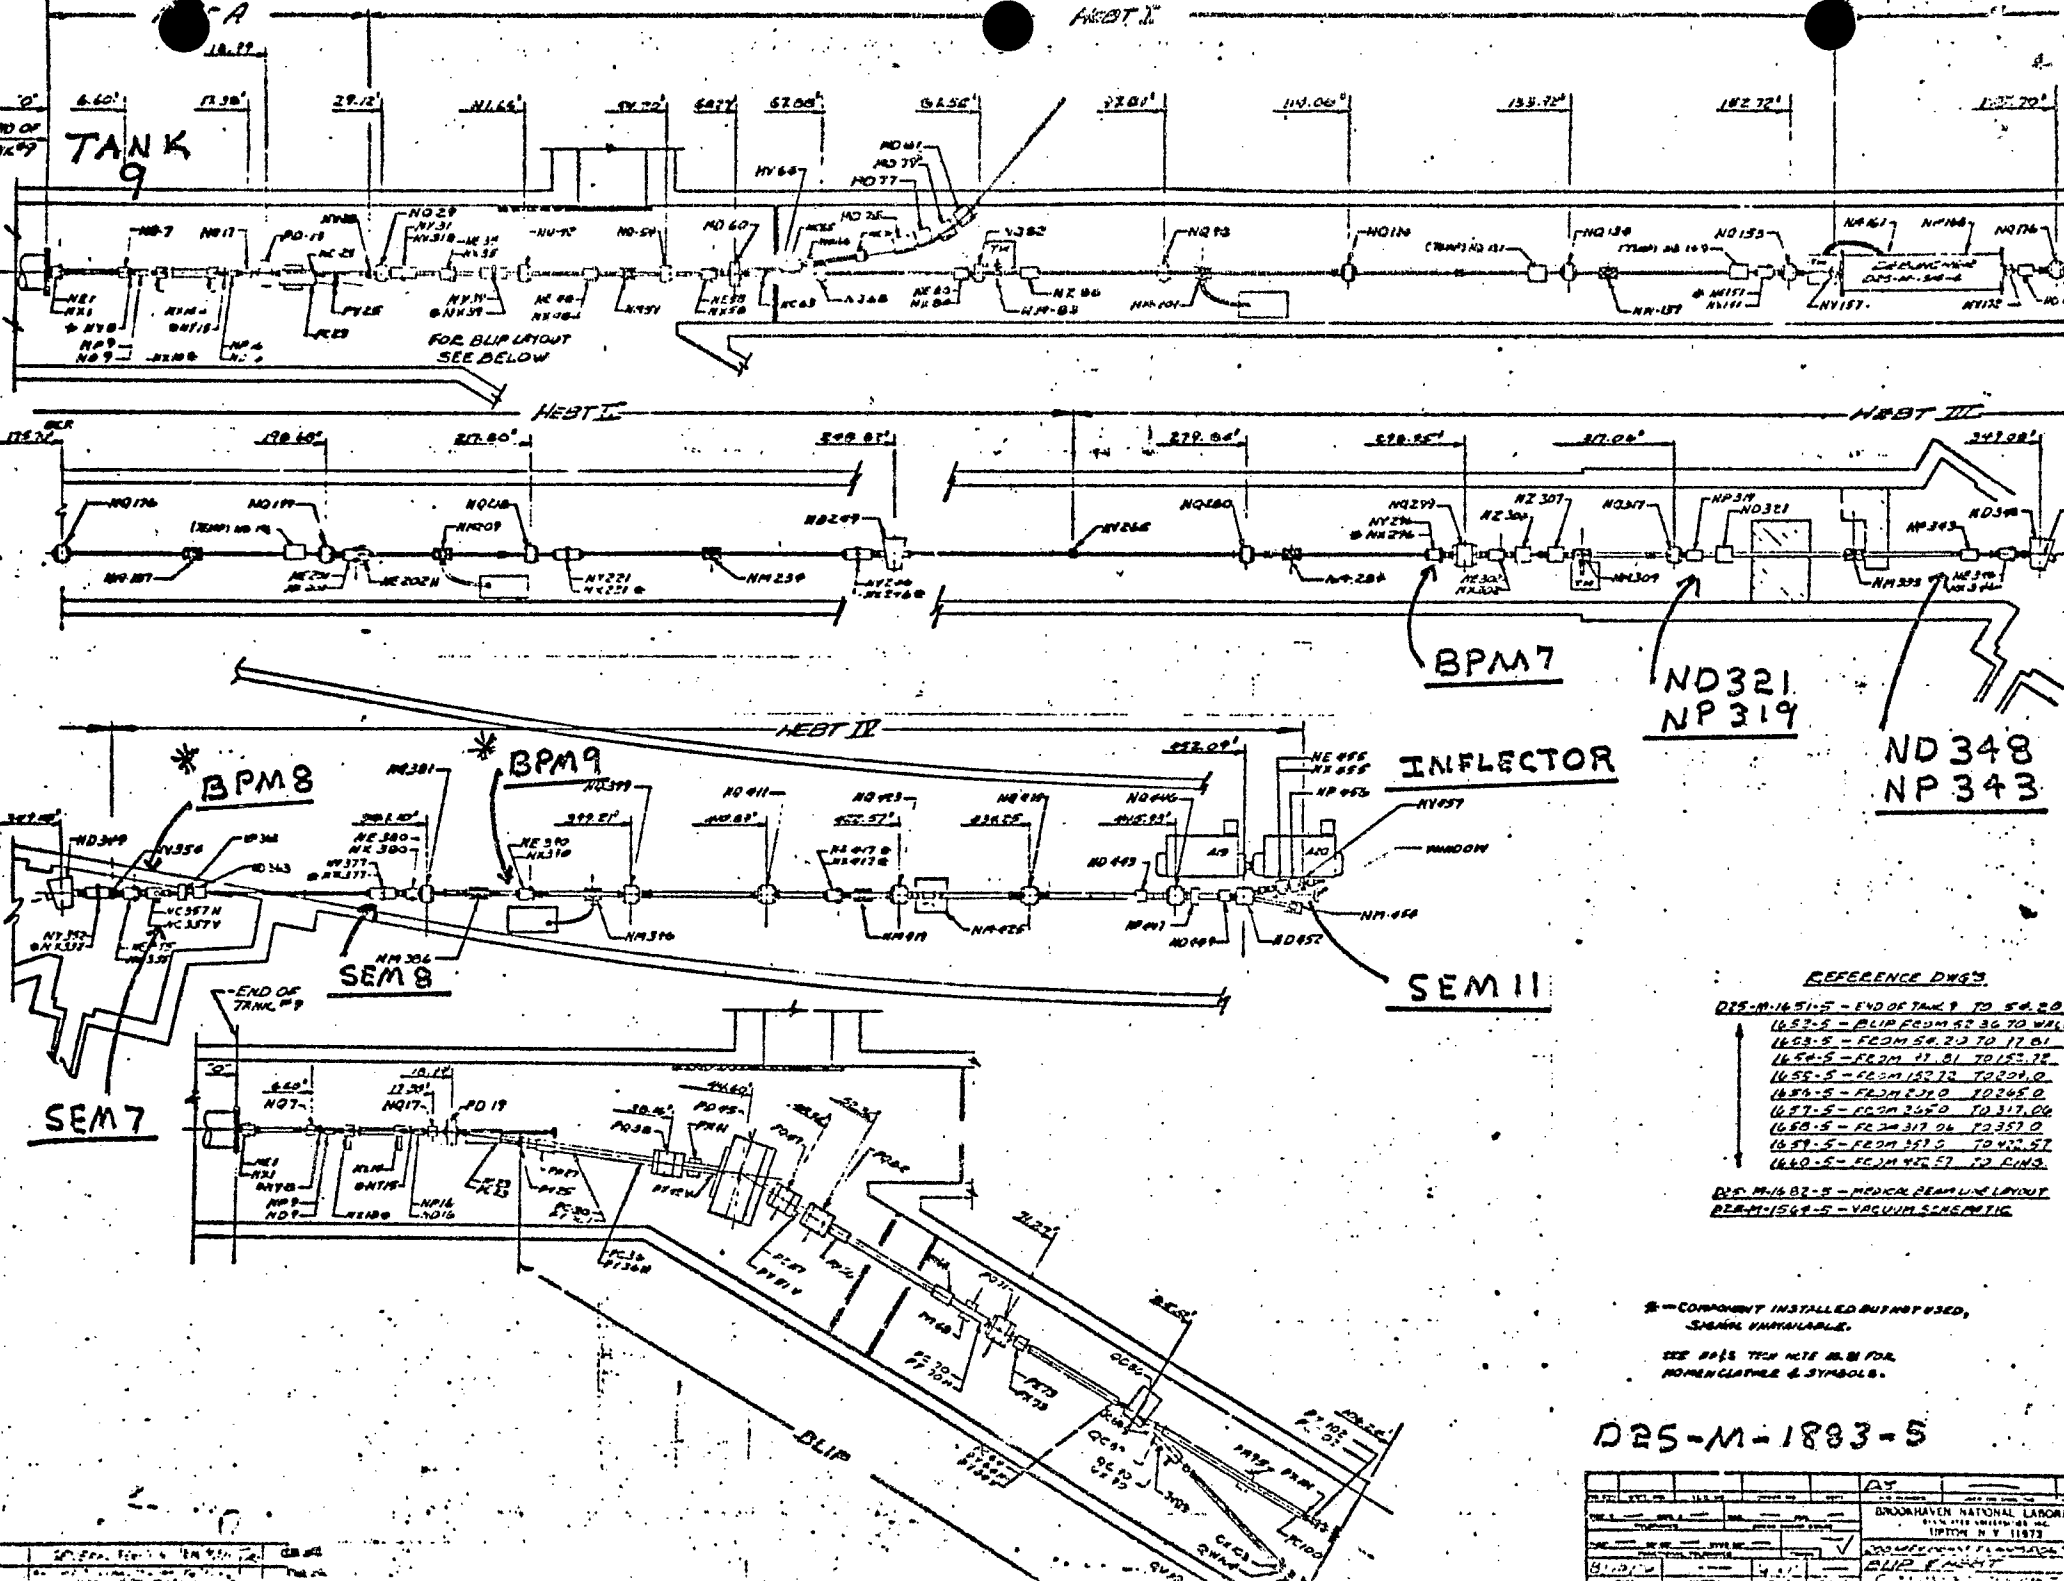

TANK 9

FOR BLIP LAYOUT SEE BELOW

BPM 7

ND 321
NP 319

ND 348
NP 343

INFLECTOR

SEM II

REFERENCE DWGS

- D25-M-1651-S - END OF TANK 9 TO 50.00
- 1652-S - BLIP FROM 52.36 TO 53.00
- 1653-S - FROM 56.23 TO 57.01
- 1654-S - FROM 57.81 TO 58.32
- 1655-S - FROM 58.72 TO 59.00
- 1656-S - FROM 59.21 TO 59.48
- 1657-S - FROM 59.65 TO 59.92
- 1658-S - FROM 60.12 TO 60.39
- 1659-S - FROM 60.56 TO 60.83
- 1660-S - FROM 61.00 TO 61.27
- D25-M-1682-S - MEDICAL ROOM LAYOUT
- D25-M-1683-S - VACUUM SYSTEMS LAYOUT


S - COMPONENT INSTALLED BUT NOT USED, SYMBOL UNAVAILABLE.
SEE PAGE TEN NOTE FOR NOMENCLATURE & SYMBOLS.

D25-M-1883-5

PROJECT NO.	1883-5	DATE	10/1/57
DESIGNED BY	W. J. ...	CHECKED BY	...
BROOKHAVEN NATIONAL LABORATORY U. S. ATOMIC ENERGY COMMISSION UTICA, N. Y. 11873			
BLIP LAYOUT			

Dis # 1

Position Monitors

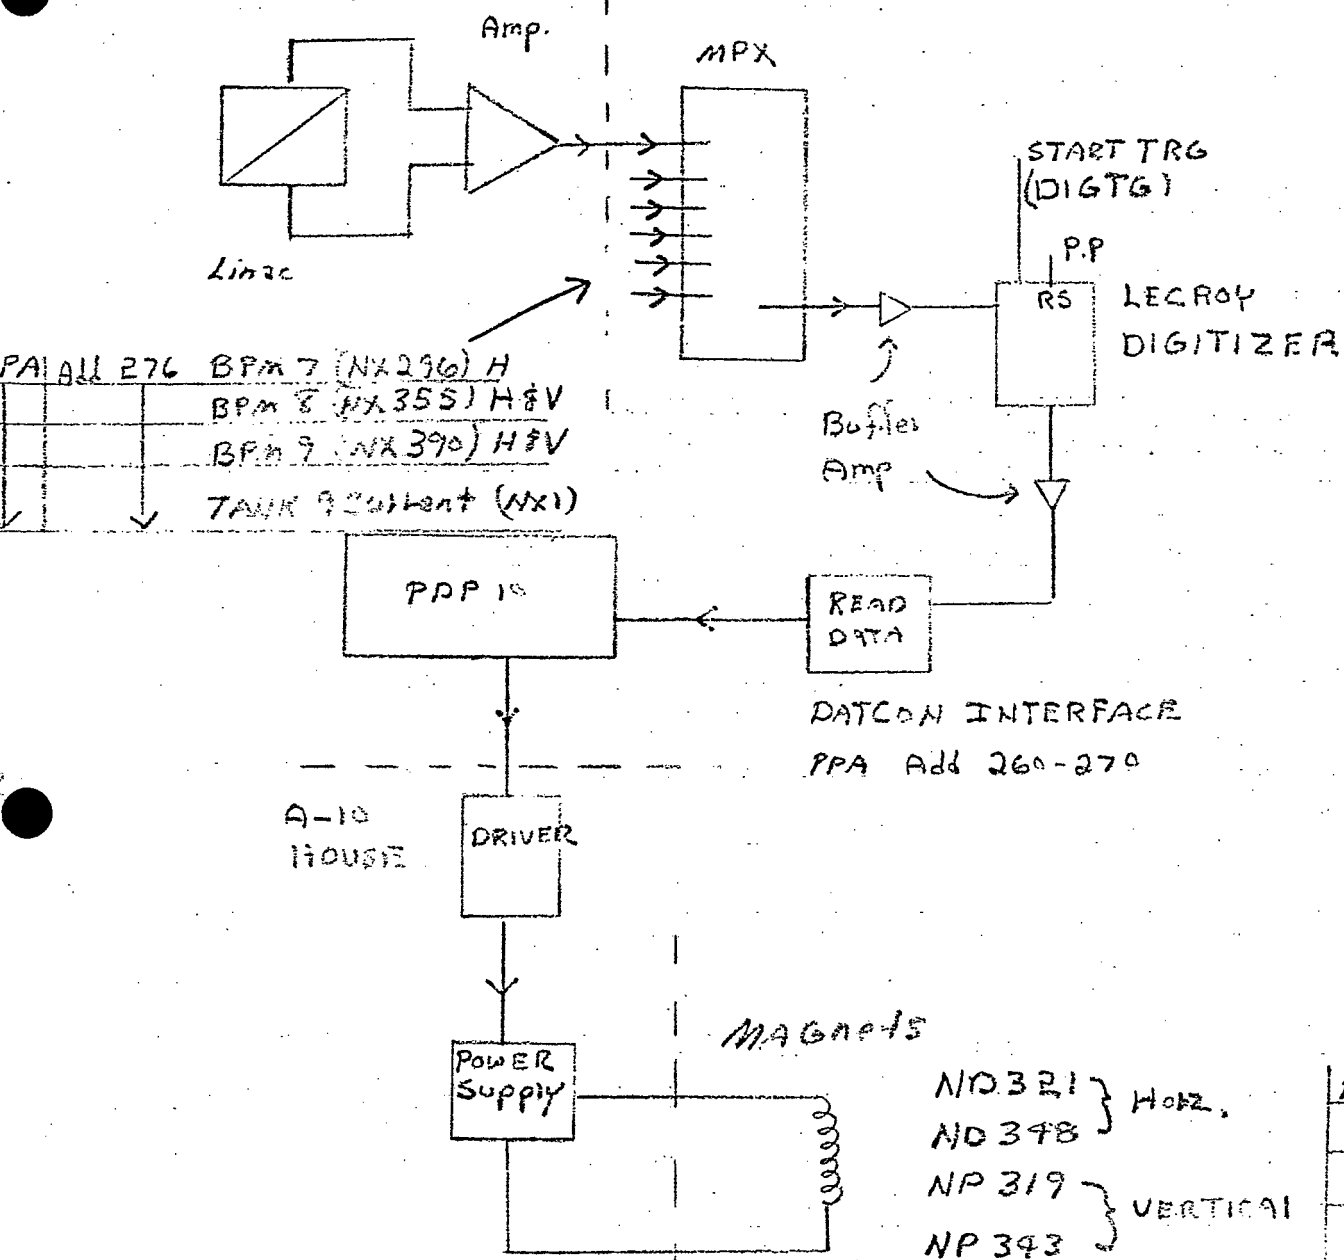


PAI	ALL 276	BPM 7 (NX 296) H
		BPM 8 (NX 355) H&V
		BPM 9 (NX 390) H&V
		TANK 9 content (NX1)

PPC	ALL 436
	437
	440
	441

- DRAWING# Position Monitor DOUBLE 1349-3
 MPX switch DO9-E499-3
 Buffer Amp DO9-E1180-2
 DATCON Interface DO9-E1161-3


+128

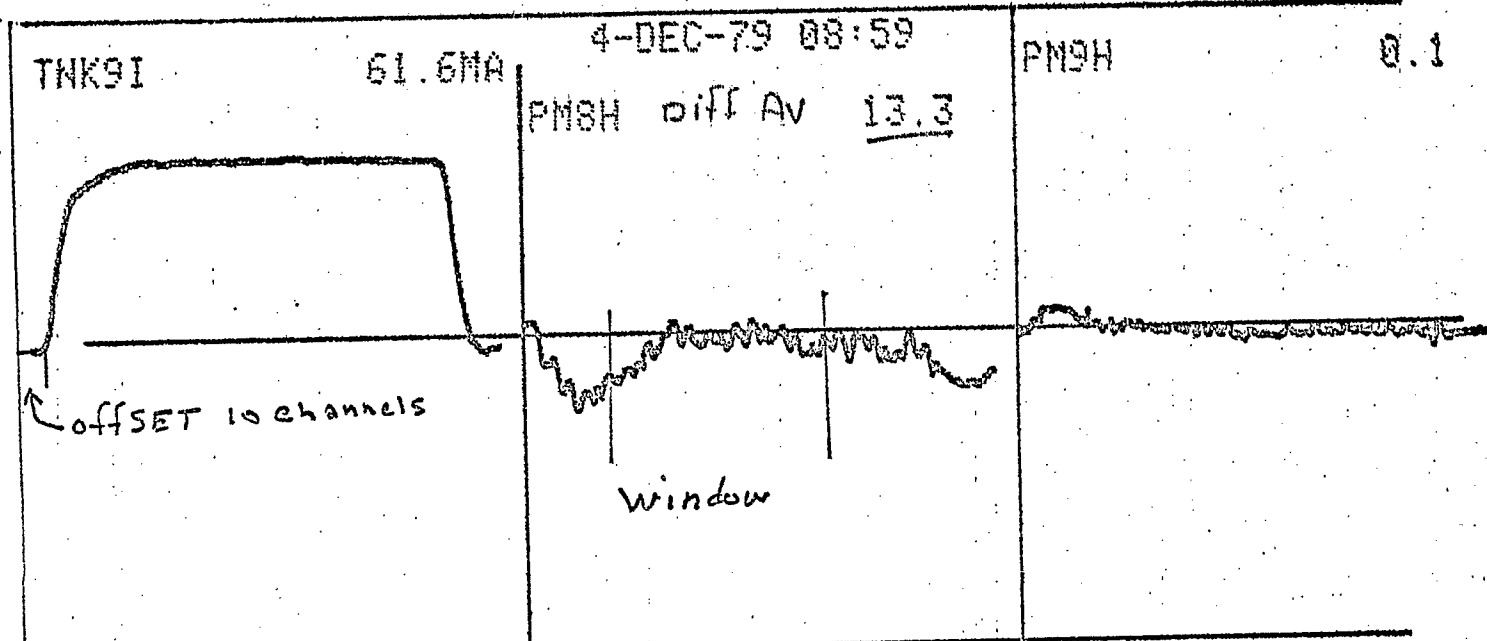

offset 10 channels

Window

-128
+128

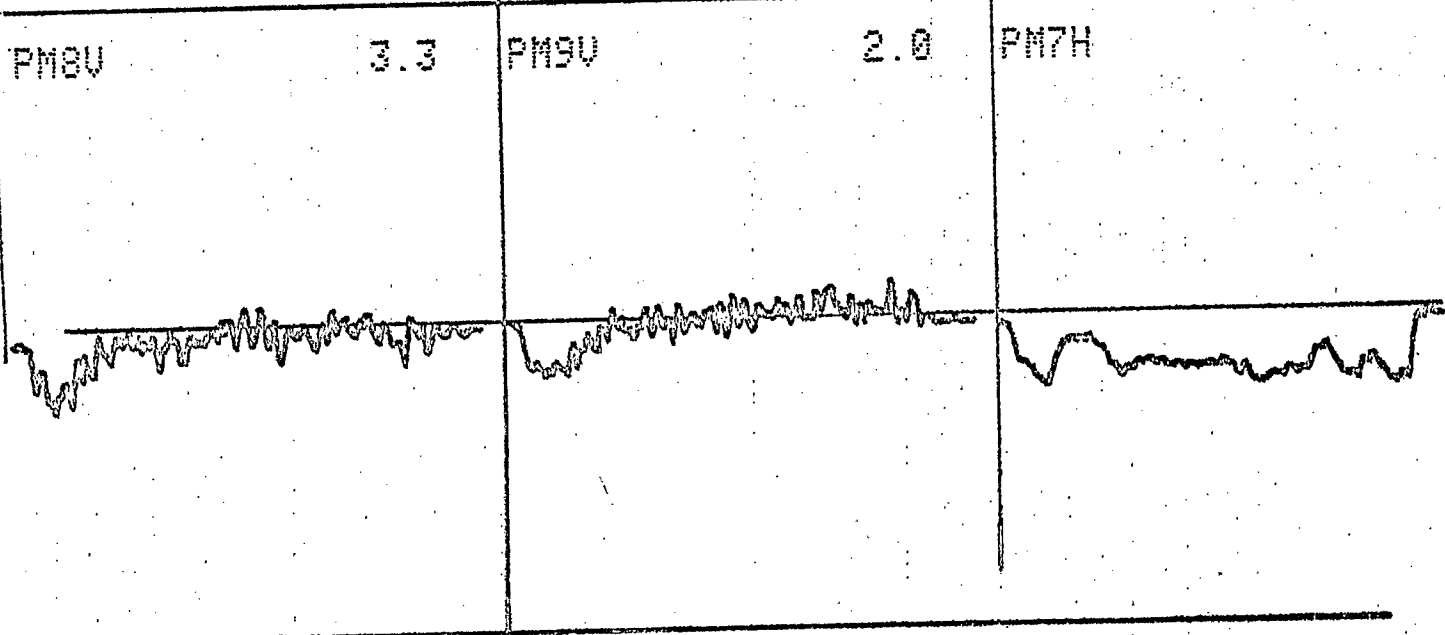

-128

1/ 1 RIN DIG .SEL 11-OCT-79 10:21 14.2
 EQUIPMENT MODE COMMAND READBACK AT UNTM

* ND321	-568	ON	-570	2	
* ND348	392	ON	395	-3	
ND449	2180	ON	2177	3	
* NP319	-92	ON	-93	1	
* NP343	569	ON	617	-40	
NP447	40	ON	40	0	
NP456	-270	ON	-269	-1	
PM8H	2	AMP	-1	3	
PM8V	3	AMP	-3	0	
PM9H	4	AMP	0	4	
PM9V	12	AMP	-1	14	
DIMXA	TNK9I			0	
DIMXB	PM7H			1	
TNK9I	1	AMP	-1	2	
PM7H	0	AMP	-2	2	
LIN ND249	465		460	450	2
DIGTG	633	ON	10US	INJ P	

1 SEL 2 SET 3 GETT 4 SAUT 5 CHNG 6 BACK 7 NEXT 8 LIB